




DELHI JAL BOARD
(GOVT. OF N.C.T. DELHI)
QUALITY CONTROL ZONAL LABORATORY (SOUTH)
WATER WORKS OKHLA DELHI-110025



Licence No- CRO/QM/L-8004290 IS/ISO 9001:2015

Ref. A.C.W.A.(South):- Paid/2023-24/P15-16/Challan no 65 Dt 16.05.2023

S. No 8062

Date: 29.05.2023

AMBIENCE PUBLIC SCHOOL
A-1, SAFDARJUNG ENCLAVE,
NEW DELHI-110029

Date of Sample collection :- 26.05.2023

S.No	Characteristics	Unit	Acceptable Limit	Permissible Limit	S.NO-01 UGT IN SCHOOL CAMPUS	S.NO. 02 TAP AQUA POINT NEAR VICE PRINCIPAL OFFICE
1.	Clarity	Unit	5	15	Clear	Clear
2.	Odour	---	Agreeable	Agreeable	Agreeable	Agreeable
3.	Turbidity	NTU	1	5	1.63	1.90
4.	pH Value	---	6.5-8.5	No relaxation	7.2	7.2
5.	Conductivity	µmho/cm ²	---	---	1132	70
6.	Total Dissolved Solids	mg/L	500	2000	736	46
1.	Phenolphthalein Alkalinity	mg/L	----	----	NIL	NIL
2.	Total Alkalinity (as CaCO ₃)	mg/L	200	600	348	24
3.	Total Hardness (as CaCO ₃)	mg/L	200	600	280	14
4.	Carbonate hardness	mg/L	----	----	280	14
5.	Non- Carbonate Hardness	mg/L	----	----	NIL	NIL
6.	Calcium Hardness	mg/L	----	----	144	08
7.	Magnesium Hardness	mg/L	----	----	136	06
8.	Ammonia (as Total N)	mg/L	0.5	No relaxation	ND	ND
9.	Nitrite (as N)	mg/L	----	----	ND	ND
10.	Nitrate	Mg/L		45.0	55	6.0
11.	Sulphate (as SO ₄)	mg/L	200	400	74	7.0
12.	Chloride (as Cl)	mg/L	250	1000	78	8.0
13.	Iron	Mg/l		1.0	0.08	0.02
14.	Fluoride	mg/L	1.0	1.5	0.43	0.10
15.	Calcium (as Ca)	mg/L	75	200	57.6	3.2
16.	Magnesium (as Mg)	mg/L	30	100	32.64	1.44
17.	Free Residual Chlorine	mg/L	0.2	1	NIL	NIL

REMARKS :- AS PER BIS-10500:2012 On the basis of tested parameters the water sample result of S.No-01 is not within permissible limit and the result of S.No-02 is within the permissible limit. Subject to Bacteriological Satisfactory report.

ACWA(SOUTH)

Assistant Chief Water Analyst
Delhi Jal Board (A Govt. of Delhi)
Zonal Laboratory (South)
W.W. Okhla New Delhi - 110 025

CHEMIST

Principal
AMBIENCE PUBLIC SCHOOL
A-1, SAFDARJUNG ENCLAVE,
NEW DELHI - 110029

A/CHEMIST

Manager
AMBIENCE PUBLIC SCHOOL
A-1, S. J. Enclave,
New Delhi-110029.

“STOP CORONA VIRUS-Wash Your Hand/Wear Mask/Maintain Social Distance”

 Delhi Jal Board	<p>DELHI JAL BOARD (GOVT. OF N.C.T. DELHI) QUALITY CONTROL ZONAL LABORATORY (SOUTH) WATER WORKS OKHLA DELHI-110025</p> <hr/> <p> भारतीय मानक ब्यूरो BUREAU OF INDIAN STANDARDS</p> <p> IS / ISO 9001 QMS</p> <p>Licence No- CRO/QM/L-8004290 IS/ISO 9001:2015</p>	 स्वच्छ भारत एक कदम स्वच्छता की ओर
--	--	---

Dated:01.06.2023

No. DJB/DTQC/ CWA (W&S)III / ACWA (south)/ Bact/P.S./2023-2024/016-017/26.05.2023


Bacteriological Analysis Report as per IS 10500:2012

To Ambience Public School A-1 Safdarjung Enclave New Delhi -110029	Party Ref.No./Date: APS/2023/Dt. 14.05.2023 Deptt.Challan No. /date: 65/16.05.2023 Dt.of sample collection: 26.05.2023 No. of Sample: Two(02) Collected by: Name- Sh. V.P Singh Desig.- Bacteriologist
--	---

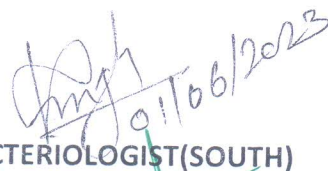
SL.No.	Particulars	Clarity	Residual chlorine	Total coliform/ E.coli in 100 ml sample
1.	UGT DJB Supply in campus of above school	Clear	Nil	2400+
2.	Tap Aqua point near vice principal's office	Clear	Nil	0

RESULT:- Collected water sample as mentioned above at Sr.No. 1 was found bacteriological unsatisfactory.

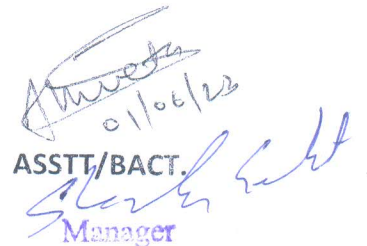
Collected water sample as mentioned above at Sr.No. 2 was found bacteriological satisfactory, hence the water/source is fit for drinking/recreational purpose subject to satisfactory attached Physical-Chemical Analysis report also.


26/6/23

ACWA (SOUTH)
Assistant Chief Water Analyst
Delhi Jal Board (A Govt. of Delhi)
Zonal Laboratory (South)
W.W. Okhla New Delhi - 110 025


01/06/2023

BACTERIOLOGIST(SOUTH)
Principal
AMBIENCE PUBLIC SCHOOL
A-1, SAFDARJUNG ENCLAVE,
NEW DELHI - 110029


01/06/23

ASSTT/BACT.
Manager
AMBIENCE PUBLIC SCHOOL
A-1, S. J. Enclave,
New Delhi-110029.



MUNICIPAL CORPORATION OF DELHI
PUBLIC HEALTH DEPARTMENT : SOUTH ZONE
GREEN PARK, AUROBINDO MARG NEW DELHI 110016

No: DHO/SZ/2022/ 73040

Dated .../.../2022

SCHOOL HEALTH CERTIFICATE

1. Name of the School	Ambience Public School			
2. School Address	A1 Safdarjung Enclave, New Delhi			
3. No. of Shift	Morning	Timing	8AM to 2PM	
4. No. of Students: Boys	885	Girls	593	Total 1478
5. No. of Staffs: Male	20	Female	82	Total 102


Details of Accommodations present in School


1. Floor Space in the Classroom Sufficient/insufficient : Sufficient
2. The Classrooms are Well Lighted/ ill lighted : Well Lighted
3. The Classrooms are Well Ventilated/ ill ventilated : Well Ventilated
4. The Classrooms are kept / Not kept Neat & Clean: kept Neat & Clean
5. The Classrooms/Building requires/ do not required Whitewash etc. Whitewash
6. The Drinking Water is Wholesome/ not wholesome : Drinking Water is Wholesome
7. The Latrine arrangement is Sanitary/ insanitary : Sanitary


No. of toilets seats for student

1. One latrine-cum-urinal is required for 25 female students are sufficient.
2. One latrine for 40 male students is required is sufficient.
3. Separate Toilet arrangement for staff present: Yes/No : Yes
4. The Overall facilities: Good/ Adequate/Inadequate : Good

If Building Department or any other Govt. agency takes actions against u/a constructions or any dispute, then the Health Certificate will be stand cancelled/revoked without any further intimation in this regard.


Principal
AMBIENCE PUBLIC SCHOOL
(Remarks: Certificate is valid for One Year)
A-1, SAFDARJUNG ENCLAVE,
NEW DELHI - 110029


Manager
AMBIENCE PUBLIC SCHOOL
A-1, S. J. Enclave,
New Delhi-110029.


Deputy Health Officer
Dr. Dzenak Mittal
South Zone, SPMIC
Public Health Officer/SZ
3/11/2022